



Most Widely Accepted and Trusted

ICC-ES Report

ESR-2528

ICC-ES | (800) 423-6587 | (562) 699-0543 | www.icc-es.org

Reissued 04/2015
This report is subject to renewal 04/2016

DIVISION: 07 00 00—THERMAL AND MOISTURE PROTECTION
SECTION: 07 32 16—CONCRETE ROOF TILES

REPORT HOLDER:

SANDSTONE INC., DBA STONEMORTH BUILDING PRODUCTS

**4025 BONNER INDUSTRIAL DRIVE
SHAWNEE, KANSAS 66226**

EVALUATION SUBJECT:

STONEMORTH BUILDING PRODUCTS FLAT AND VENETIAN CONCRETE ROOF TILES



Look for the trusted marks of Conformity!

“2014 Recipient of Prestigious Western States Seismic Policy Council (WSSPC) Award in Excellence”



ICC-ES Evaluation Reports are not to be construed as representing aesthetics or any other attributes not specifically addressed, nor are they to be construed as an endorsement of the subject of the report or a recommendation for its use. There is no warranty by ICC Evaluation Service, LLC, express or implied, as to any finding or other matter in this report, or as to any product covered by the report.



ICC-ES Evaluation Report**ESR-2528***

Reissued April 2015

This report is subject to renewal April 2016.www.icc-es.org | (800) 423-6587 | (562) 699-0543

A Subsidiary of the International Code Council®

**DIVISION: 07 00 00—THERMAL AND MOISTURE
PROTECTION****Section: 07 32 16—Concrete Roof Tiles****REPORT HOLDER:****SANDSTONE INC., dba STONEWORTH BUILDING
PRODUCTS****4025 BONNER INDUSTRIAL DRIVE
SHAWNEE, KANSAS 66226
(913) 422-0794**www.stoneworthcompany.com**EVALUATION SUBJECT:****STONEWORTH BUILDING PRODUCTS FLAT AND
VENETIAN CONCRETE ROOF TILES****1.0 EVALUATION SCOPE****Compliance with the following codes:**

- 2006 *International Building Code*® (IBC)
- 2006 *International Residential Code*® (IRC)

Properties evaluated:

- Durability
- Fire classification
- Wind uplift resistance

2.0 USES

The Flat and Venetian concrete roof tiles are used as Class A roof coverings in accordance with the exception to Section 1505.2 of the IBC and Section R902.1 of the IRC.

3.0 DESCRIPTION

The Flat and Venetian tiles are manufactured from portland cement, sand, water, coloring agents and admixture, and comply with ASTM C1492. Mineral coloring oxides are mixed with the portland cement to produce color through the entire tile. Both tiles are 16¹/₂ inches (419 mm) long and 13 inches (330 mm) wide, and have longitudinal edges that form interlocking ribs and grooves designed to restrict lateral movement and provide a weather check.

3.1 Flat Tile:

The Flat tiles are approximately 1¹/₂ inches (38 mm) high, and are classified as Type II tiles in accordance with ASTM C1492. Two nail holes are provided at the top portion of each tile, with protruding head lugs on the underside to provide mechanical attachment over battens.

The tiles are installed with a head lap of 3 inches (76 mm) and a side lap of 1.35 inches (34 mm), and have an installed weight of 10¹/₂ psf (51 kg/m²). See Figure 1 for tile profile and dimensions with matching ridge, rake and hip units.

3.2 Venetian Tile:

The Venetian tiles are approximately 3 inches (76 mm) high, and are classified as Type I tiles in accordance with ASTM C1492. Two nail holes are provided at the top portion of each tile, with protruding head lugs on the underside to provide mechanical attachment over battens. The tiles are installed with a head lap of 3 inches (76 mm) and a side lap of 1.27 inches (32 mm), and have an installed weight of 9¹/₂ psf (46 kg/m²). See Figure 2 for tile profile and dimensions with matching ridge, rake and hip units.

4.0 INSTALLATION**4.1 General:**

Except as otherwise noted in this report, the tiles must be installed in accordance with the Concrete and Clay Roof Tile Installation Manual for Moderate Climate Regions, published by the Tile Roofing Institute, Inc., and the Western States Roofing Contractors Association (herein referred to as the TRI/WSRCA installation manual), dated March 2010. This report and the current TRI/WSRCA installation manual must be available at the jobsite at all times during installation.

4.2 Adhesively Attached Systems:

The Flat and Venetian concrete roof tiles may be installed with roof tile adhesives that are recognized in a current ICC-ES evaluation report for use in concrete roof tile applications. Installation of tiles using these adhesively attached systems must be in accordance with the adhesive manufacturer's ICC-ES evaluation report.

4.3 Roof Slope Limitations:

Tiles must be installed on roof slopes of between 2¹/₂:12 (21 percent) and 21:12 (175 percent).

4.4 Underlayment:

For adhesively attached systems, underlayment must be in accordance with the adhesive manufacturer's ICC-ES evaluation report.

4.5 Fire Classification:

When installed in accordance with this report, the Flat and Venetian concrete roof tiles are Class A roof coverings in accordance with the exception to IBC Section 1505.2 and IRC Section R902.1.

***Revised July 2015**

4.6 Wind Uplift Resistance:

4.6.1 Mechanically Fastened Systems: For applications beyond the prescriptive parameters of IBC Table 1507.3.7 and IRC Section R905.3.7, documentation must be submitted to the code official showing that the fastening systems are capable of withstanding the aerodynamic uplift moment, in accordance with the Design Considerations for High Wind Applications in Appendix B of the TRI/WSRCA installation manual.

4.6.2 Adhesively Attached Systems: See the adhesive manufacturer’s ICC-ES evaluation report.

4.7 Reroofing Applications:

The tiles may be installed over existing roofs, provided the requirements of IBC Section 1510 or IRC Section R907, as applicable, are met. The roof classification is as noted in Section 4.5.

5.0 CONDITIONS OF USE

The Flat and Venetian concrete roof tiles described in this report comply with, or are suitable alternatives to what is specified in, those codes listed in Section 1.0 of this report, subject to the following conditions:

5.1 The tiles must be manufactured, identified and installed in accordance with this report, the applicable code, and the TRI/WSRCA installation manual, dated March 2010. The instructions within this report govern if there are any conflicts between the installation manual and this report.


5.2 The roof sheathing and roof framing system must be designed for the appropriate loads determined in accordance with the applicable code, subject to the approval of the code official.

6.0 EVIDENCE SUBMITTED

Data in accordance with the ICC-ES Acceptance Criteria for Clay and Concrete Roof Tiles (AC180), dated August 2007.


7.0 IDENTIFICATION

Each Venetian tile is embossed with the words “Vortex Hydra Italy,” or “CFL.” Additionally, each Flat tile is identified with the embossments “Sandstone” and “Vortex Hydra Italy.” Each shipping pallet is identified with the Stoneworth Building Products name and address; the manufacturing location; the product name (Flat or Venetian); the installed weight; and the evaluation report number (ESR-2528).

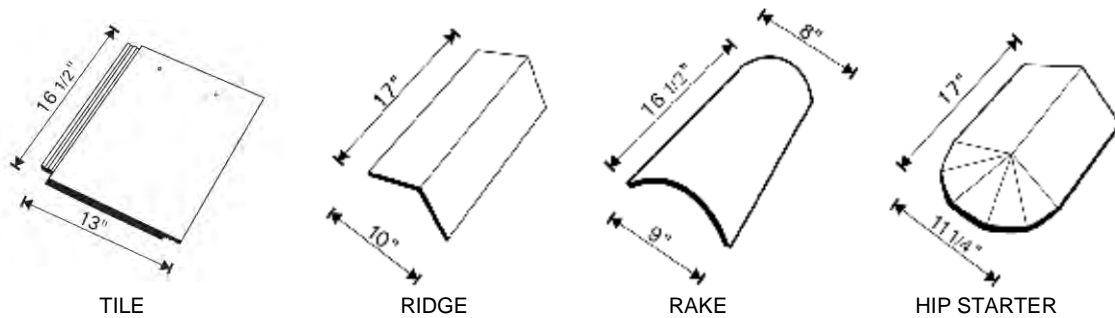

For SI: 1 inch = 25.4 mm.

FIGURE 1—FLAT TILE WITH RIDGE, RAKE AND HIP UNITS

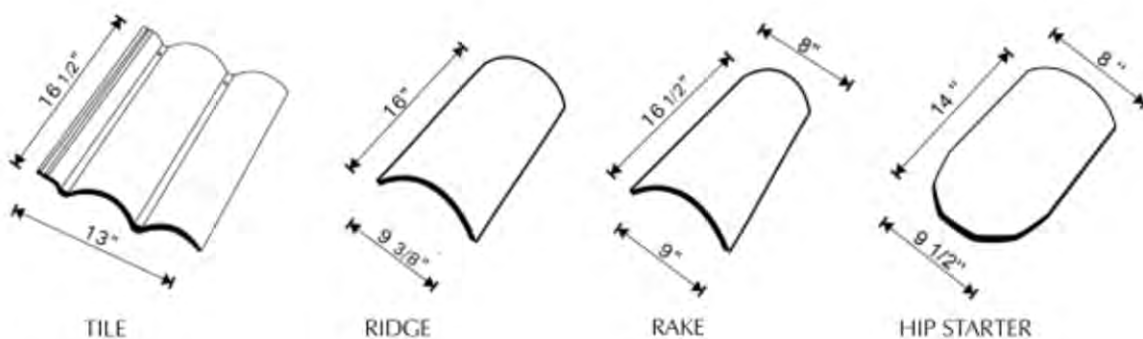

For SI: 1 inch = 25.4 mm.

FIGURE 2—VENETIAN TILE WITH RIDGE, RAKE AND HIP UNITS